


NOTES

- * ALL DIMENSIONS ARE IN MILLIMETERS. LEVELS ARE IN METERS, UNLESS STATED OTHERWISE. DRAWING SHOULD NOT BE SCALED. FOLLOW WRITTEN DIMENSIONS ONLY.
- * THIS DRAWING IS TO BE READ WITH RELEVANT ARCH., STRUC., MECH. & ELEC. DRAWINGS.
- * SOIL BEARING CAPACITY IS ASSUMED TO BE 300 KN/m². THE CONTRACTOR SHALL VERIFY THE ACTUAL SOIL BEARING CAPACITY BEFORE PROCEEDING WITH THE WORKS.
- * ALL BLINDING CONCRETE SHALL HAVE A MINIMUM CRUSHING STRENGTH OF 15N/mm².
- * ALL REINFORCED CONCRETE SHALL HAVE A MINIMUM CRUSHING STRENGTH OF 30N/mm² USING ORDINARY PORTLAND CEMENT AND 20mm MAXIMUM SIZE AGGREGATE.
- * BLOCK WORK SHALL HAVE A MINIMUM CRUSHING STRENGTH OF 7N/mm².
- * REINFORCEMENT COVER FOR REINF. CONCRETE BELOW AND ABOVE GROUND : 65mm
- * ABOVE GROUND - COLUMNS: 25mm (INTERNAL)
- COLUMNS: 40mm (EXTERNAL)
- BEAMS : 25mm (INTERNAL)
- BEAMS : 40mm (EXTERNAL)
- SLABS : 20mm

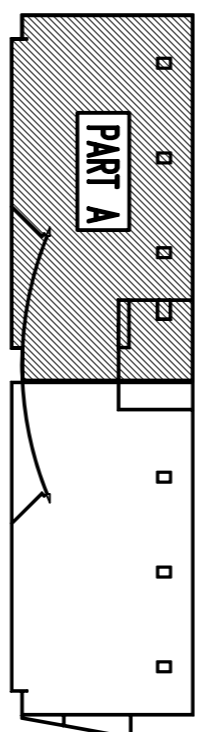

KEY PLAN

REV.	DESCRIPTION	BY	DATE

ENGINEERS COMMENTS / APPROVAL

CONSULTANT

 Grid Design Solutions P.Ltd
 Techno Park, Thiruvananthapuram,
 Kerala, India-695033
 Fax : +91471272797

SUB CONTRACTOR
 OWNER
 LOCATION
 DISCIPLINE : STRUCTURAL
 PROJECT :
 DRAWING TITLE

SCALE	CHECKED	K.C
DATE	PROJ. NO.	
DRAWN	M.P	
DESIGNED	DRG. NO.	